

Supplement to the user information

„SILENTIO“ system control

Fill level measuring device and drinking water supply

Item no.: 351022

10. Special functions:

b) Alarm indicator contact:

As an additional function, your unit is equipped with a potential-free alarm indicator contact. This contact is designed as a changeover contact element. A maximum of 230V AC is approved when a current of 1A is switched. The activation of this contact occurs as soon as one of the malfunctions listed under Point 6 appears. The picture on the following page shows the location of the connections. These become available as soon as the lower cover of the system control unit is opened (see diagram 1).

Before opening this cover, it is important to disconnect the device from the mains electricity supply!

Explanation of terms:

- COM is the common port
- NC is coupled to the COM port when there is no current.
- NO is connected to the COM port when there is a malfunction

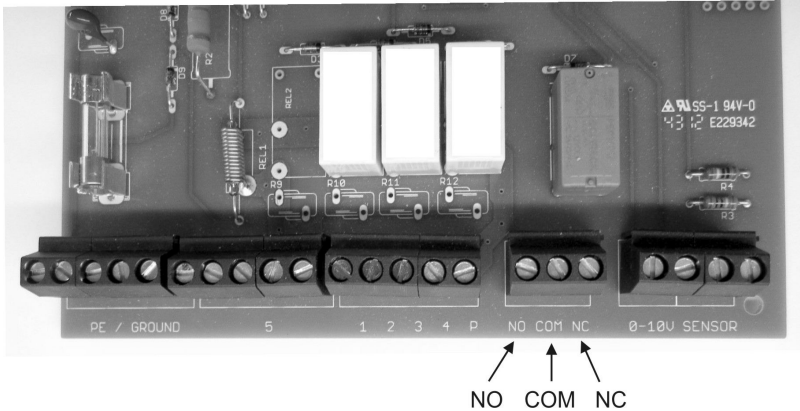


Diagram 19: location of the fault indicator

The M 12 opening on the underside of the system control device must be opened and the cable drawn through. Place the supplied grommet into the opening and pass the cable through into the system control.

Design and specifications are subject to change without notice
Dated: December 2012
Version: SI 3.1c